

COORDINATE WITH UNL PM & PROVIDE PHOTOCELL DLL127 1.5 LP BK PER PROJECT REQUIREMENTS. REFER TO PLANS & LUMINAIRE SCHEDULE FOR EXACT FIXTURE TYPE & QUANTITY OF HEADS.


LITHONIA DSX SERIES - 4000K CCT, BLACK FINISH, PER7 SEVEN-WIRE RECEPTACLE, DRIVE CURRENT & DISTRIBUTION BY DESIGN PER NU GUIDELINES SEE LUMINAIRE SCHEDULE

* POLE BASE LENGTH (L) BELOW FINISHED GRADE AND DIAMETER (D) AS FOLLOWS:

TOP OF POLE HEIGHT (HT) AFG	CONCRETE BASE LENGTH BELOW GRADE & DIAMETER
0' < HT ≤ 15'	→ 48" L x 16" D
15' < HT ≤ 29'	→ 60" L x 20" D
29' < HT ≤ 40'	→ 72" L x 24" D

† WHERE PVC ELBOWS ARE PROVIDED, PROVIDE FLAT TYPE PULL LINE/TAPE/ROPE.

30'-0" MAX.
REFER TO LUMINAIRE SCHEDULE

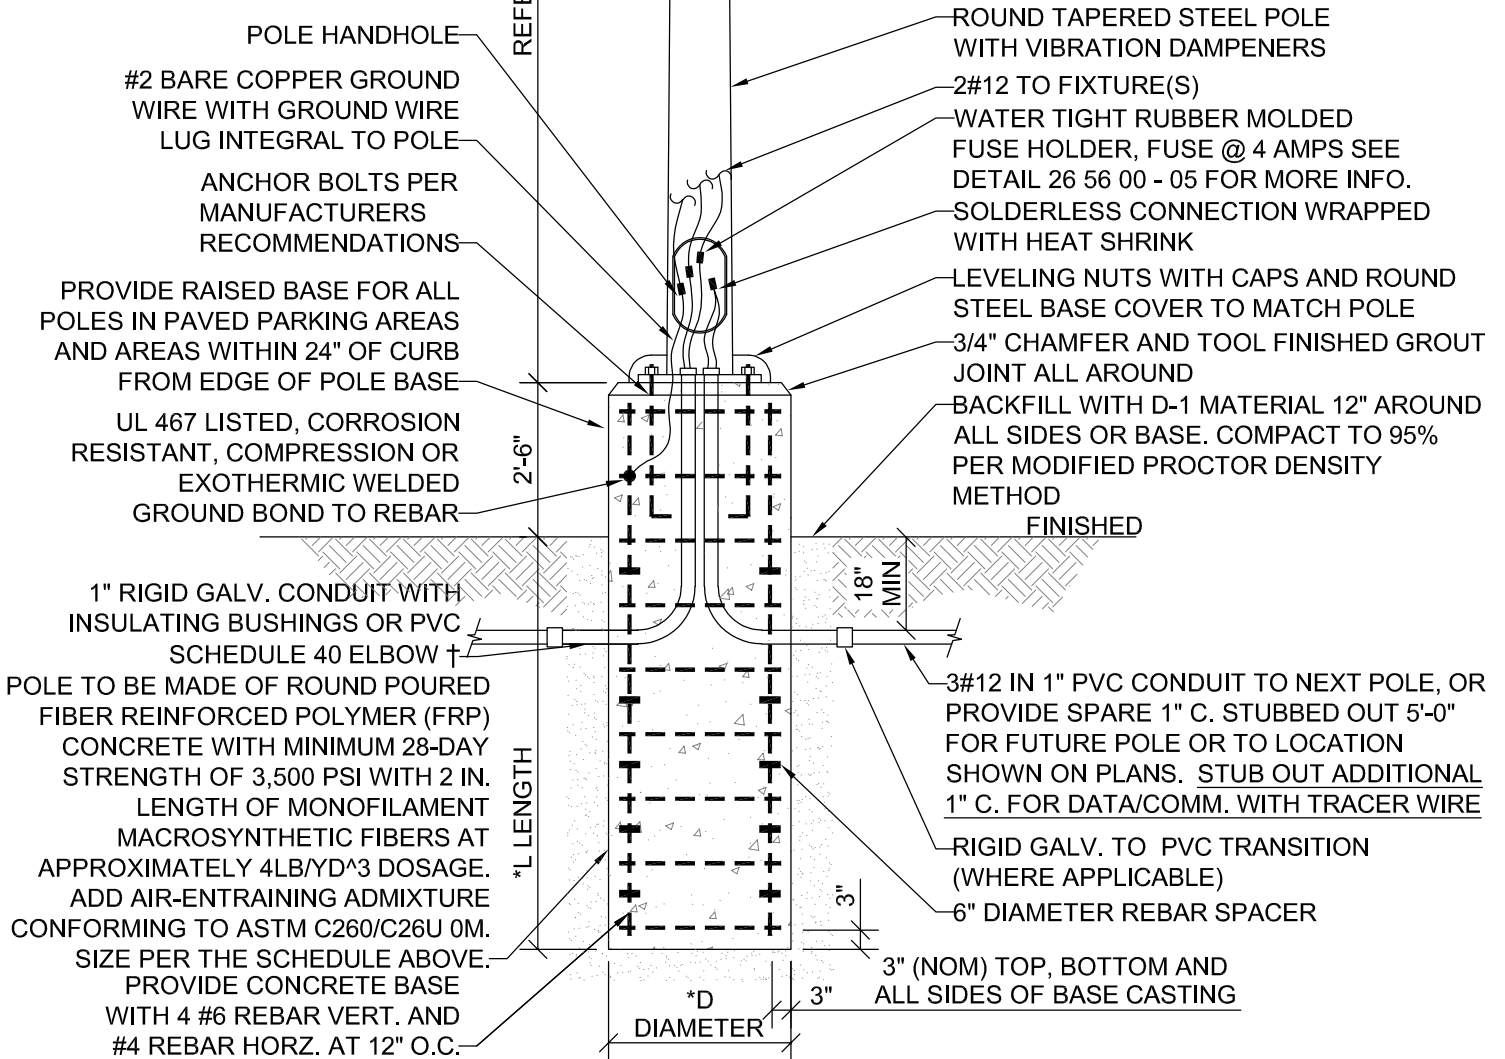

PARKING LOT & STREET LIGHT POLE BASE DETAIL

1
E1.01

SCALE: NO SCALE

Detail Title: PARKING LOT & STREET LIGHT POLE BASE DETAIL	Detail No.: 26 56 00 - 01	Facilities, Planning & Capital Programs Standard Detail	
Scale: N.T.S.	Date: JULY 2024		