


GENERAL NOTES

1. ALL COMPONENTS ASSOCIATED WITH INSTALLATION TO BE RATED FOR 212°F.
2. PIPE DIAMETER MAY BE CHANGED ON A PROJECT BY PROJECT BASIS.

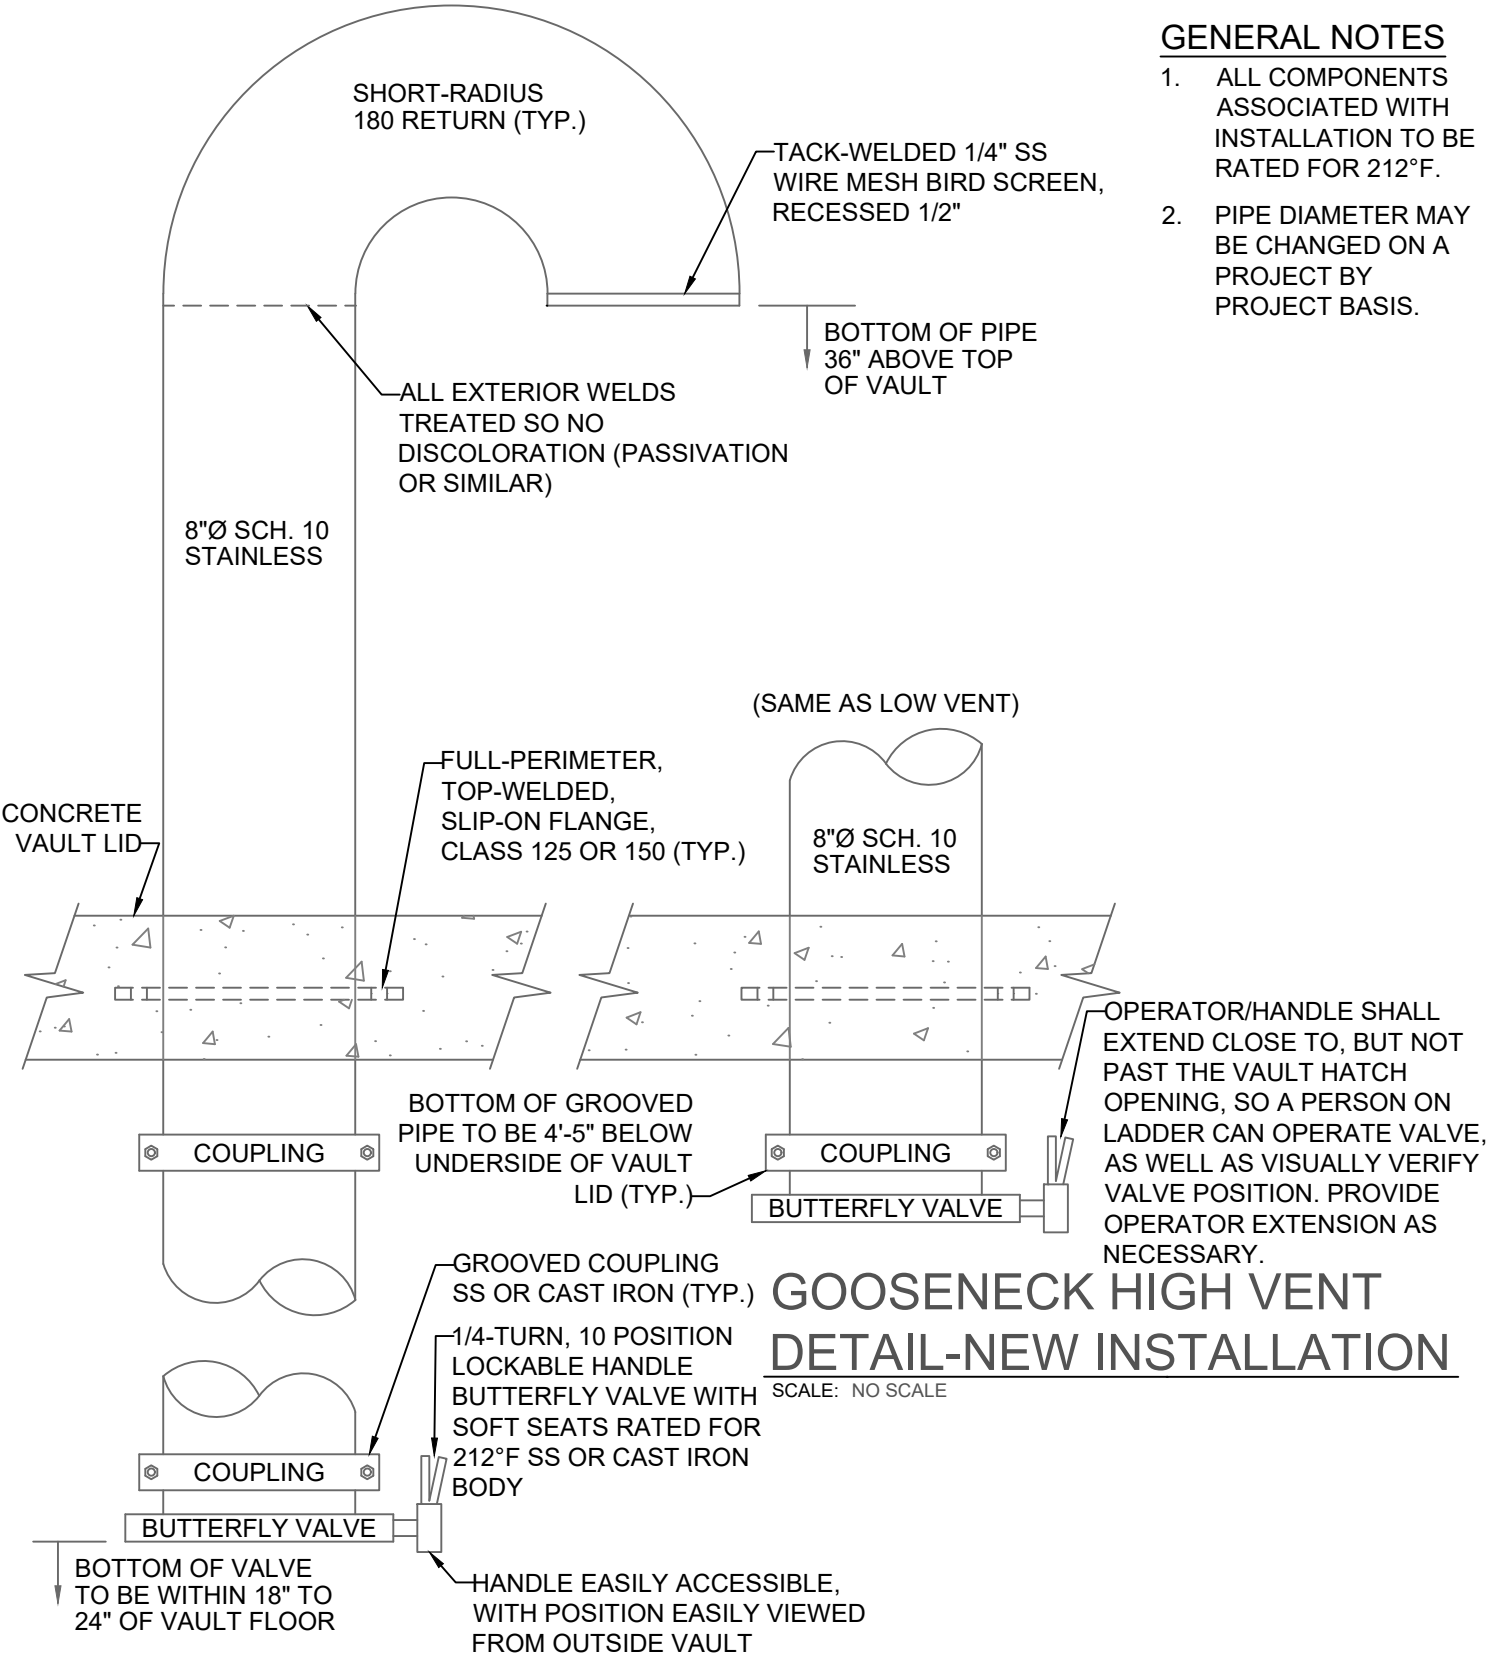


**GOOSENECK HIGH VENT
DETAIL-NEW INSTALLATION**

SCALE: NO SCALE

**GOOSENECK LOW VENT
DETAIL-NEW INSTALLATION**

SCALE: NO SCALE

<p>Detail Title: High Vent and Low Vent Detail New Installation</p>	<p>Detail No.: 33 05 13 - 03</p> <p>Scale: N.T.S.</p> <p>Date: October 2020</p>	<p>Facilities, Planning & Capital Programs Standard Detail</p>	
---	---	--	---