


GENERAL NOTES

1. MINIMUM SUMP INTERIOR DIMENSIONS OF 3' X 3' X 30", OR 30" X 3' DIA.
2. HIGH TEMPERATURE (200°F) RATED PUMP (CONTINUOUS SUBMERGENCE) AND HARD-WIRED HIGH TEMPERATURE (200°F) FLOAT. NO CONTROL PANELS, EVEN FOR DUPLEX PUMPS.

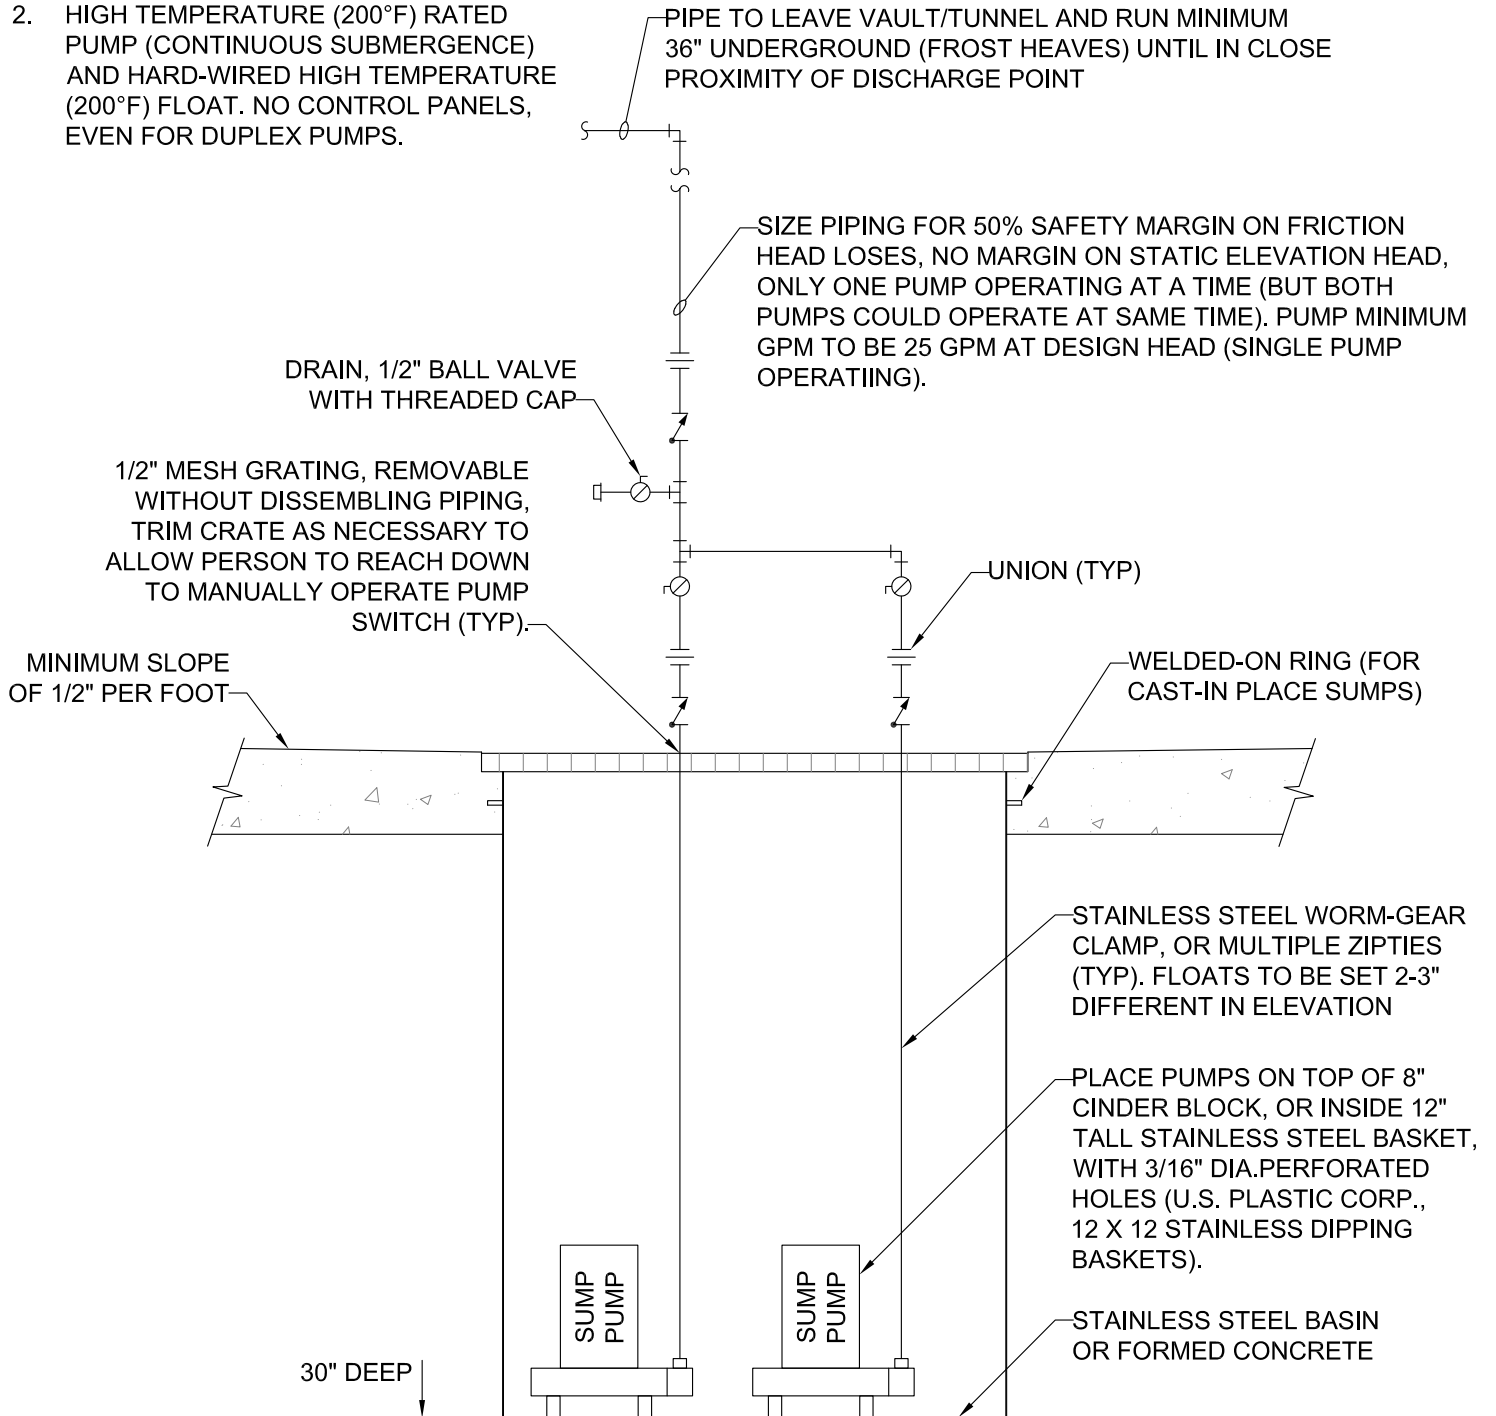

1 VAULT OR TUNNEL SUMP PUMP DETAIL

A1.01 SCALE: NO SCALE

Detail Title:	Detail No.:	33 05 13 - 04	Facilities, Planning & Capital Programs Standard Detail	
Vault or Tunnel Sump Pump Detail	Scale:	N.T.S.		
	Date:	January 2022		