


KEY NOTES


1. STRAP-ON TEMPERATURE SENSOR PROVIDED BY UNL, INSTALLED BY CONTRACTOR.
2. STEAM CONDENSATE MAG METER PROVIDED BY UNL, INSTALLED BY CONTRACTOR. MINIMUM 6" CLEARANCE FROM METER TO BACKING WALL. METER MAY BE INSTALLED IN ANY ORIENTATION. FLOW METER SIZING BY UNL BSM, MINIMUM SIZE IS 1".

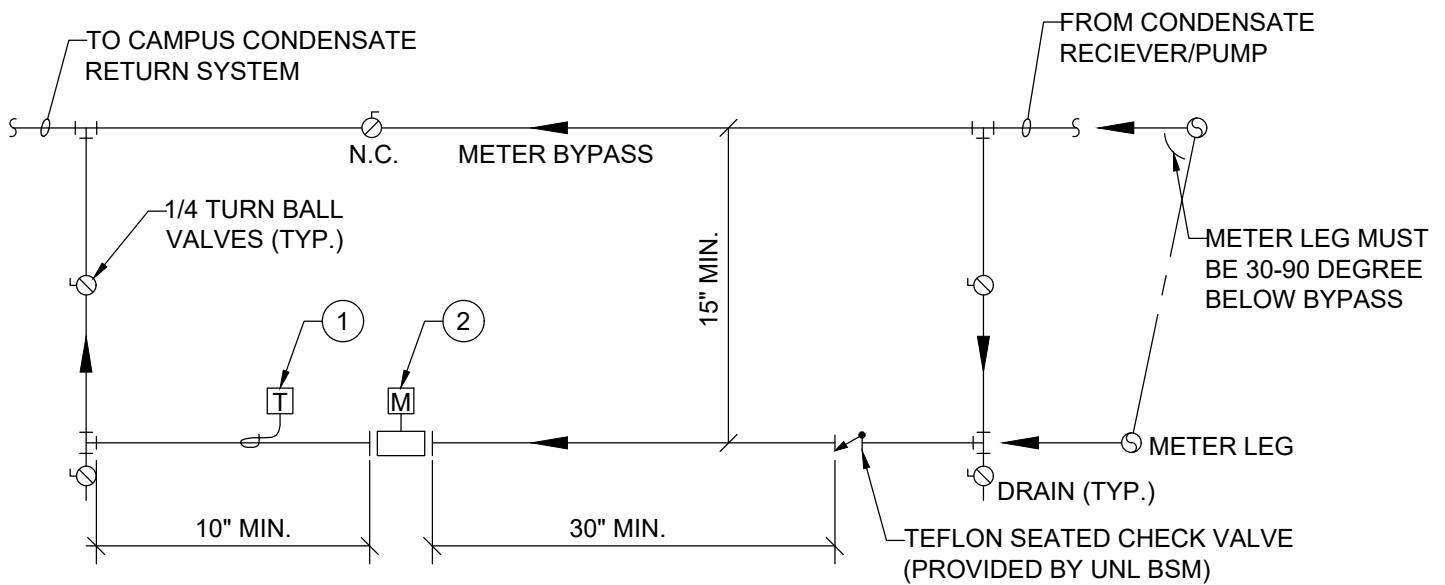

STEAM CONDENSATE METER PIPING SCHEMATIC

1
A1.01

SCALE: NO SCALE

Detail Title: STEAM CONDENSATE METER PIPING SCHEMATIC	Detail No.: 33 63 00 - 02 Scale: N.T.S. Date: October 2020	Facilities Planning & Construction Standard Detail	
---	--	---	---